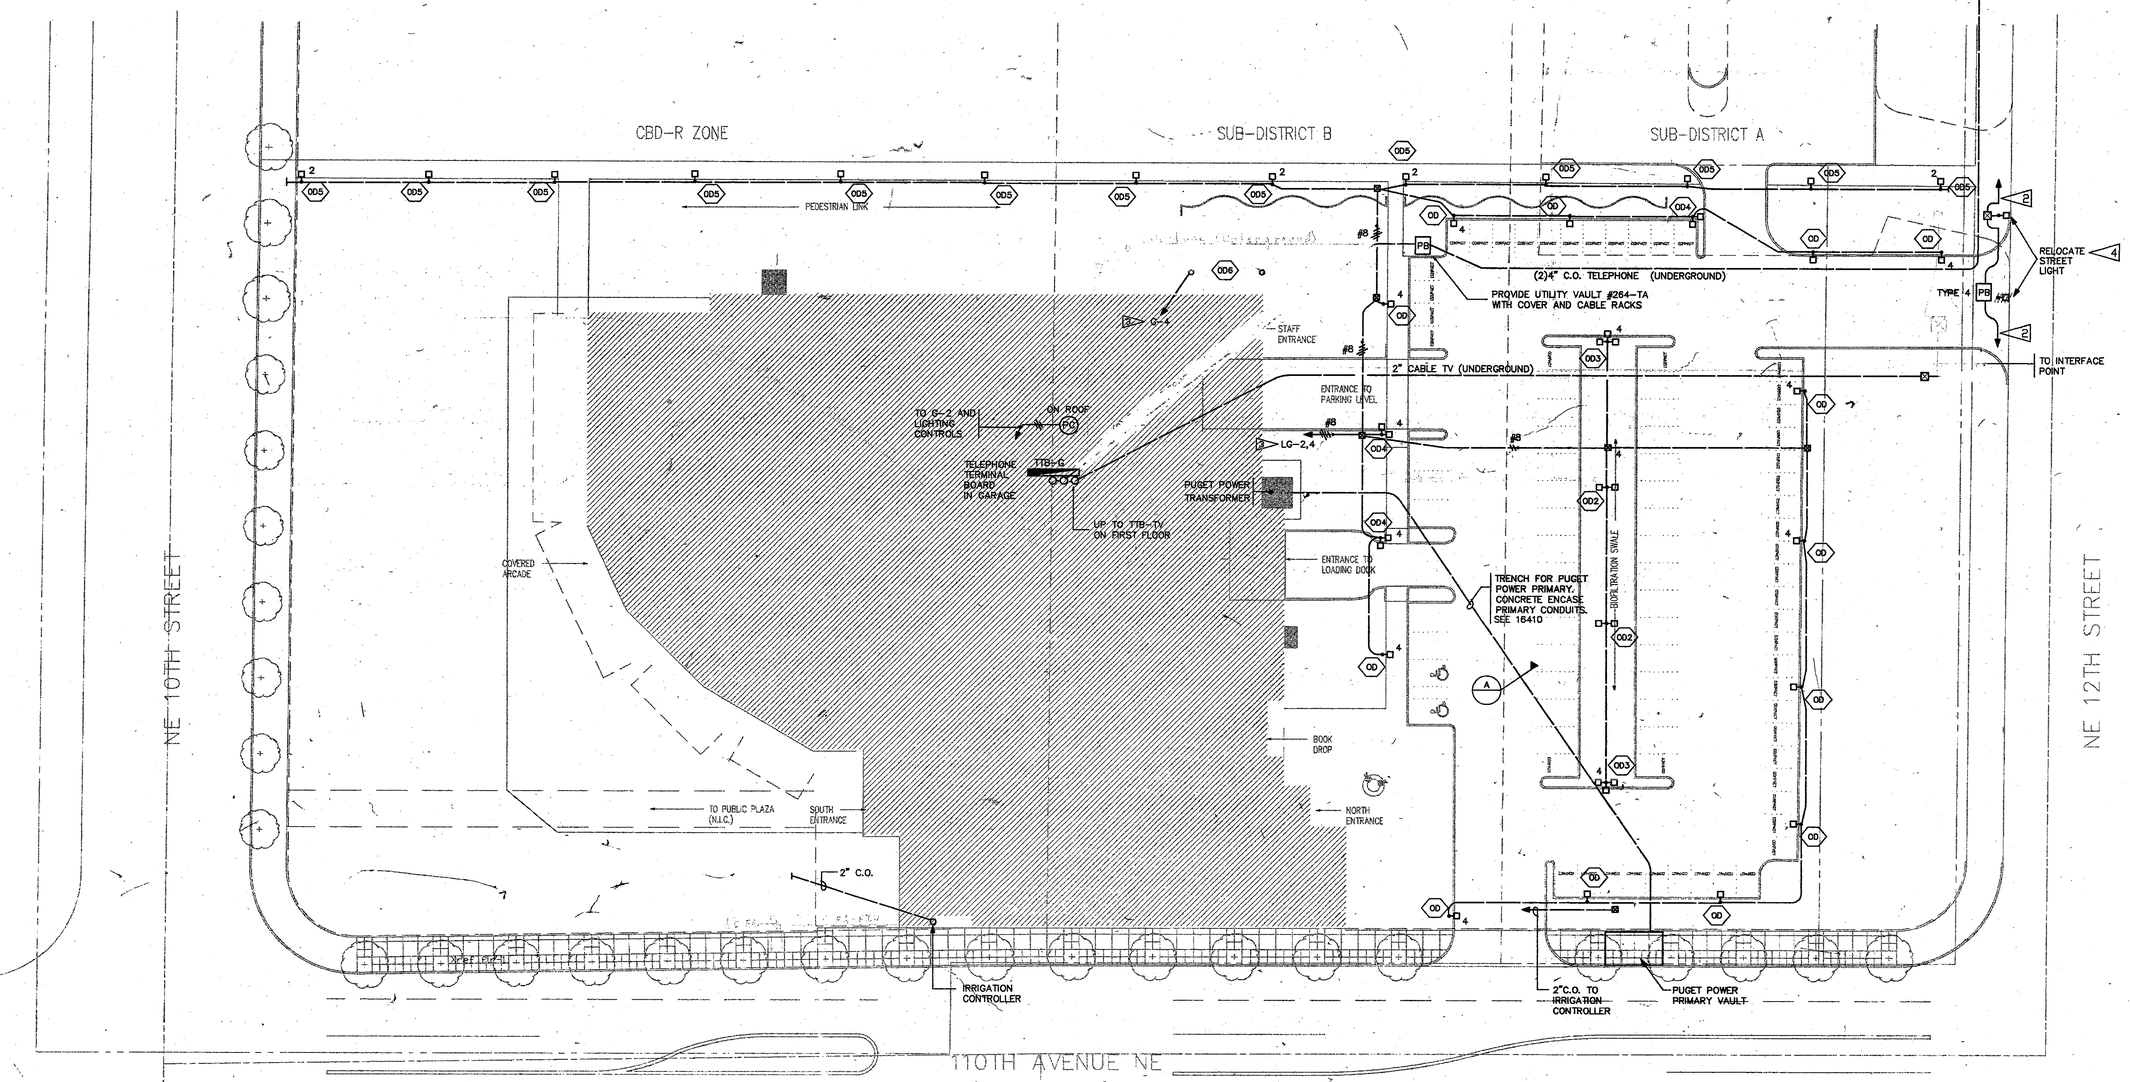

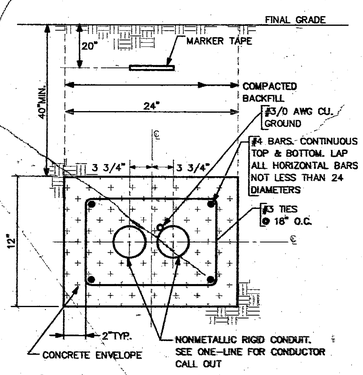

A UNDERGROUND PRIMARY DUCT SECTION
NOT TO SCALE

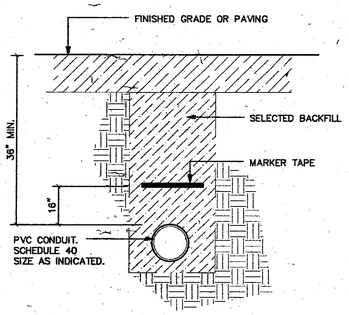

TYPICAL DIRECT BURIED 600 VOLT CONDUIT DETAIL
NOT TO SCALE

ELECTRICAL SITE PLAN
SCALE: 1" = 20'-0"

FLAG NOTES:

1. REFER TO LANDSCAPE DRAWING FOR EXACT LOCATIONS OF ALL OUTDOOR FIXTURES. TYPICAL.
2. PROVIDE NEW CONDUCTORS MATCHING EXISTING TO NEXT STREET LIGHT.
3. PROVIDE WIRING VIA LIGHTING CONTROLS TO GIVE THE FOLLOWING OPERATION. PROVIDE 2#10 AND #10G UNLESS SHOWN OTHERWISE.
   a. CKT LG-2: PHOTOCELL ON/OFF VIA CONTACTOR #1.
   b. CKT LG-4 PHOTOCELL ON, TIME CLOCK OFF VIA CONTACTOR #2.
   c. CKT G-4 : PHOTOCELL ON, TIME CLOCK OFF VIA CONTACTOR #2.
4. PROVIDE RELOCATION PER CITY OF BELLEVUE STANDARDS.
5. PROVIDE POLEBASES PER DETAIL DRAWING E11.

Date FEBRUARY 3, 1992
Revision No. 2/3/92 BID DOCUMENTS
Design Department
Technical Department
Job Captain
Drawn By

Architecture/Planning/Interior Design
ZIMMER·GUNSUL·FRASCA PARTNERSHIP
Portland Seattle Newport Beach

ELECTRICAL SITE PLAN
BELLEVUE LIBRARY
KING COUNTY LIBRARY SYSTEM

SPARLING
Job No. 4030-01
E1
of Sheets

Jan 30, 1992 - 18:23:35 J:\5216\SITE.DWG